

WRF04 CO2

Combined room sensor CO₂ / temperature / humidity

thermokon[®]
Sensortechnik GmbH

Datasheet

Subject to technical alteration
Issue date: 2/26/2016



Application

Surface mounted sensor for detection of CO₂, temperature and optional relative humidity in room and office spaces. For direct connection to a DDC or a monitoring system, using 0..10 V outputs. Also available with traffic light LED and LCD display.

Types Available

WRF04 CO2 VV	2x outputs 0..10 V / temperature, CO ₂
3xV	3x outputs 0..10 V / temperature, CO ₂ , humidity

Optional

WRF04 CO2 xx	LCD	LCD for displaying measuring values
	TLF	3 LEDs for displaying level of CO ₂ concentration
	R	Potential free relay output (NO) for 24 V ~ or 24 V = / 2 A with adjustable CO ₂ threshold value

Security Advice – Caution



The installation and assembly of electrical equipment should only be performed by authorized personnel.

The product should only be used for the intended application. Unauthorised modifications are prohibited! The product must not be used in relation with any equipment that in case of a failure may threaten, directly or indirectly, human health or life or result in danger to human beings, animals or assets. Ensure all power is disconnected before installing. Do not connect to live/operating equipment.

Please comply with

- Local laws, health & safety regulations, technical standards and regulations
- Condition of the device at the time of installation, to ensure safe installation
- This data sheet and installation manual

Notes on Disposal



As a component of a large-scale fixed installation, Thermokon products are intended to be used permanently as part of a building or a structure at a pre-defined and dedicated location, hence the Waste Electrical and Electronic Act (WEEE) is not applicable. However, most of the products may contain valuable materials that should be recycled and not disposed of as domestic waste. Please note the relevant regulations for local disposal.

Remarks to Room Sensors

Location and Accuracy of Room Sensors

The room sensor should be mounted in a suitable location for measuring accurate room temperature. The accuracy of the temperature measurement also depends directly on the temperature dynamics of the wall. It is important, that the back plate is completely flush to the wall so that the circulation of air occurs through the vents in the cover. Otherwise, deviations in temperature measurement will occur due to uncontrolled air circulation. Also the temperature sensor should not be covered by furniture or similar devices. Mounting next to doors (due to draught) or windows (due to colder outside wall) should be avoided.

The temperature dynamics of the wall will influence the temperature measurement. Various wall types (brick, concrete, dividing and hollow brickwork) all have different behaviours with regards to thermal variations.

Surface and Flush Mounting

The temperature dynamics of the wall influence the measurement result of the sensor. Various wall types (brick, concrete, dividing and hollow brickwork) have different behaviours with regard to thermal variations. A solid concrete wall responds to thermal fluctuations within a room in a much slower way than a light-weight structure wall. Room temperature sensors installed in flush boxes have a longer response time to thermal variations. In extreme cases they detect the radiant heat of the wall even if the air temperature in the room is lower for example. The quicker the dynamics of the wall (temperature acceptance of the wall) or the longer the selected inquiry interval of the temperature sensor is the smaller the deviations limited in time are.

Build-up of Self-Heating by Electrical Dissipative Power

Temperature sensors with electronic components always have a dissipative power, which affects the temperature measurement of the ambient air. The dissipation in active temperature sensors shows a linear increase with rising operating voltage. This dissipative power has to be considered when measuring temperature. In case of a fixed operating voltage ($\pm 0,2$ V) this is normally done by adding or reducing a constant offset value. As Thermokon transducers work with a variable operating voltage, only one operating voltage can be taken into consideration, for reasons of production engineering. Transducers 0..10 V / 4..20 mA have a standard setting at an operating voltage of 24 V =. That means, that at this voltage, the expected measuring error of the output signal will be the least. For other operating voltages, the offset error will be increased by a changing power loss of the sensor electronics. If a re-calibration should become necessary later directly on the sensor, this can be done by means of a trimming potentiometer on the sensor board.

Remark: Occurring draft leads to a better carrying-off of dissipative power at the sensor. Thus temporally limited fluctuations might occur upon temperature measurement.

Application Notice for Humidity Sensors

Refrain from touching the sensitive humidity sensor/element. Touching the sensitive surface will void warranty.

For standard environmental conditions re-calibration is recommended once a year to maintain the specified accuracy. When exposed to high ambient temperature and/or high levels of humidity or presence of aggressive gases (i.e. chlorine, ozone, ammonia) the sensor element may be affected and re-calibration may be required sooner than specified. Re-calibration and deterioration of the humidity sensor due to environmental conditions are not subject of the general warranty.

Information about Indoor Air Quality CO₂

EN 13779 defines several classes for indoor air quality:

Category	CO ₂ content above the content in outdoor air in ppm		Description
	Typical range	Standard value	
IDA1	<400 ppm	350 ppm	Good indoor air quality
IDA2	400.. 600 ppm	500 ppm	Standard indoor air quality
IDA3	600..1.000 ppm	800 ppm	Moderate indoor air quality
IDA4	>1.000 ppm	1.200 ppm	Poor indoor air quality

Information about Self-Calibration Feature CO₂

All gas sensors are subject to drift caused by components. This fact results generally in the need to recalibrate the sensors regularly.

With dual channel technology Thermokon integrates automatic self-calibration for different fields of operation. In contrast to common used ABC-Logic sensors with self-calibration dual channel are suitable for applications operating 24 hours, 7 days a week as for example hospitals.


Manual calibration is not necessary!

Technical Data





Measuring values		CO ₂ , temperature, humidity
Output voltage	VV 3xV	2x 0..10 V (min. load 10 kΩ) 3x 0..10 V (min. load 10 kΩ)
Power supply		15..24 V = (±10%) or 24 V~ (±10%)
Power consumption		max. 3 W (24 V = 6 VA (24 V =)
Measuring range temperature		+32..+122 °F
Measuring range humidity		0..100% rH non-condensing
Measuring range CO ₂		0..2000 ppm
Accuracy temperature		±1% of measuring range (typ. at 70 °F)
Accuracy humidity		±2% between 10..90% rH (typ. at 70 °F)
Accuracy CO ₂		±75 ppm or 10% of measuring range (typ. at 70 °F), whatever is greater
Calibration		self-calibration, dual channel
Sensor		NDIR (non-dispersive, infrared)
Display		LCD 1.14x0.47 in., monochrome (optional) 3 LEDs showing air quality (traffic light function 'TLF') (optional)
Enclosure		PC, pure white
Protection		IP30 according to EN 60529
Cable entry		breaking points top/bottom, entry on rear
Connection electrical		terminal block, max. 15AWG
Ambient condition		+32..+122 °F, max. 85% rH non-condensing
Weight		3.17 oz.
Notes		relay ,R' (optional): floating, max. 24 V / 2 A (ohmic)

Connection plan

1 GND-wire for short connection wires

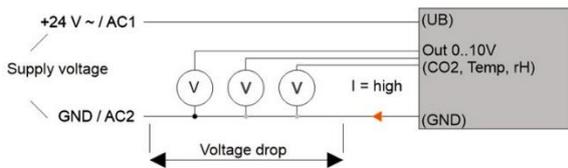

2 GND-wires for long connection wires

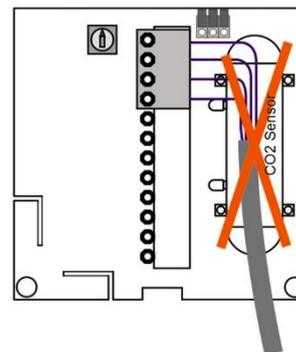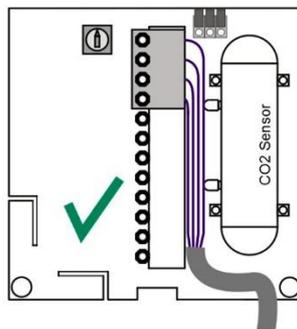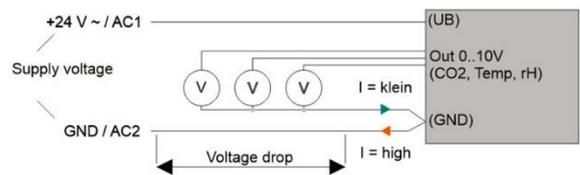

Clamp	Type WRF04 CO2 VV	Type WRF04 CO2 3xV
1	GND/AC2	GND/AC2
2	UB +24 V ~/AC1	UB +24 V ~/AC1
3	Temp. 0..10 V	Temp. 0..10 V
4	CO ₂ 0..10 V	CO ₂ 0..10 V
5	Not used	Rel. humidity 0..10 V
6	Not used	Not used
7	Not used	Not used
8	relay C (only option -R)	relay C (only option -R)
9	relay NO (only option -R)	relay NO (only option -R)
10	relay NC (only option -R)	relay NC (only option -R)

Functions description


Traffic light function (optional)

The LEDs visualize the air quality

0..33%		0..750 ppm	green LED flashing
34..66%		751..1250 ppm	yellow LED flashing
67..100%		1251..2000 ppm	red LED flashing

Configuration

P1	Offset temperature	±3 K	
P2	Offset CO ₂	±150 ppm	
P3	Offset rel. humidity	±15% rH	mode switch position 0
	CO ₂ set point		mode switch position 2

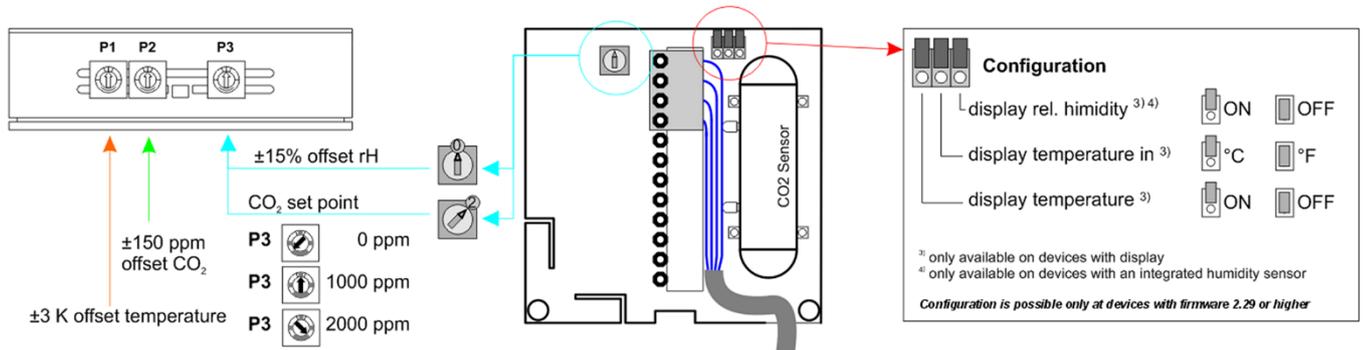

For configuration set mode switch to the appropriate position and then choose offset or set point using P1 to P3. With changing P1 to P3 the value is stored in the device.

Changing set point will not change offset for rel. humidity, if the mode switch has been set to the correct position.


Mounting Advices

Make sure that the device is power-off, if you install it!


The device can be installed on a smooth wall surface or a flush box. A representative location for room temperature without direct insolation should be selected for the device.

The use of deep installation boxes is recommended due to increased storage capacity for the wires. Empty tubes have to be sealed to avoid air draught from the installation tube.

- (1) For wiring, the upper part of the base plate has to be removed. Base plate and upper part are connected via snap tab located in the middle of the enclosure bottom.
- (2) The installation of the base plate to the smooth wall surface can be done either by sticking using the enclosed adhesive film (A) as well as using plugs and screws.
- (3) Finally the device is clicked into the base plate.

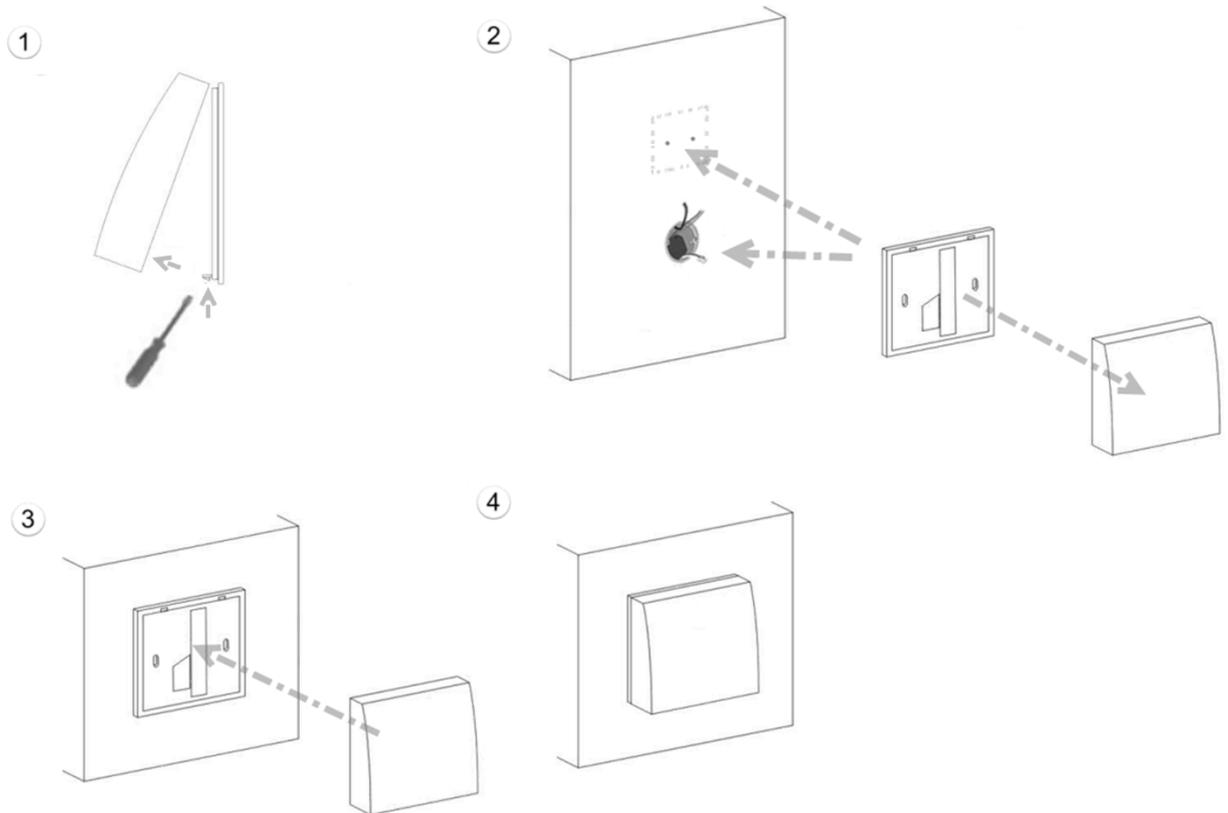

Dimensions (in.)

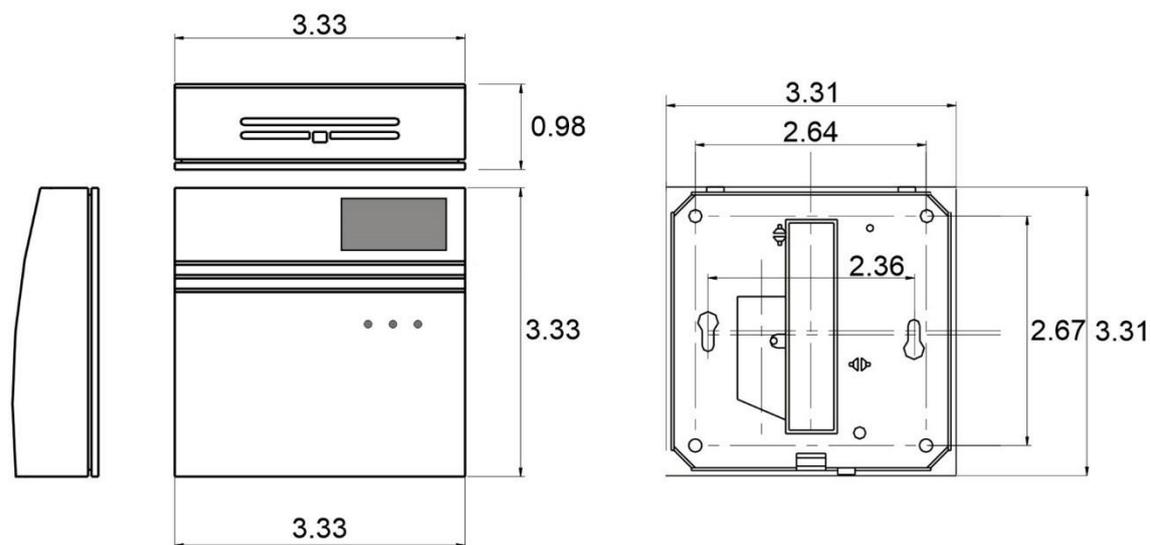

Accessories

Rawlplugs and screws (2 pcs. each)
 Frame for surface mounting WRF04
 Ball stroke protection BS100

Item No.: 102209
 Item No.: 111584
 Item No.: 103312